



**San Patricio Electric Cooperative - 361-364-2220**  
**Underground Meter Loop – Self Supporting**

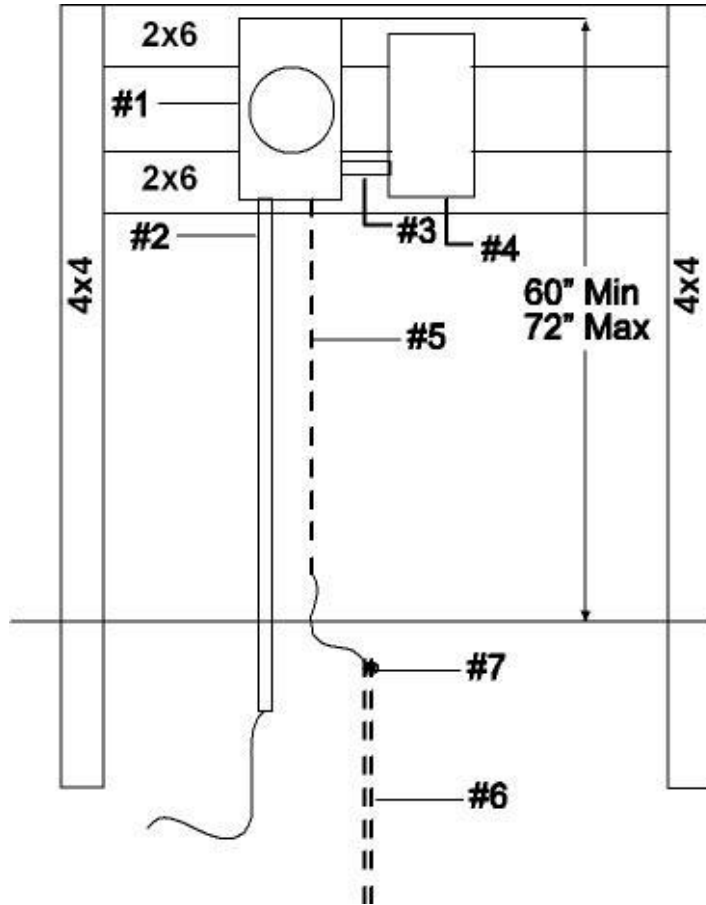

**200 Amp UnderGround Meter Loop with Galvanized Nipple**

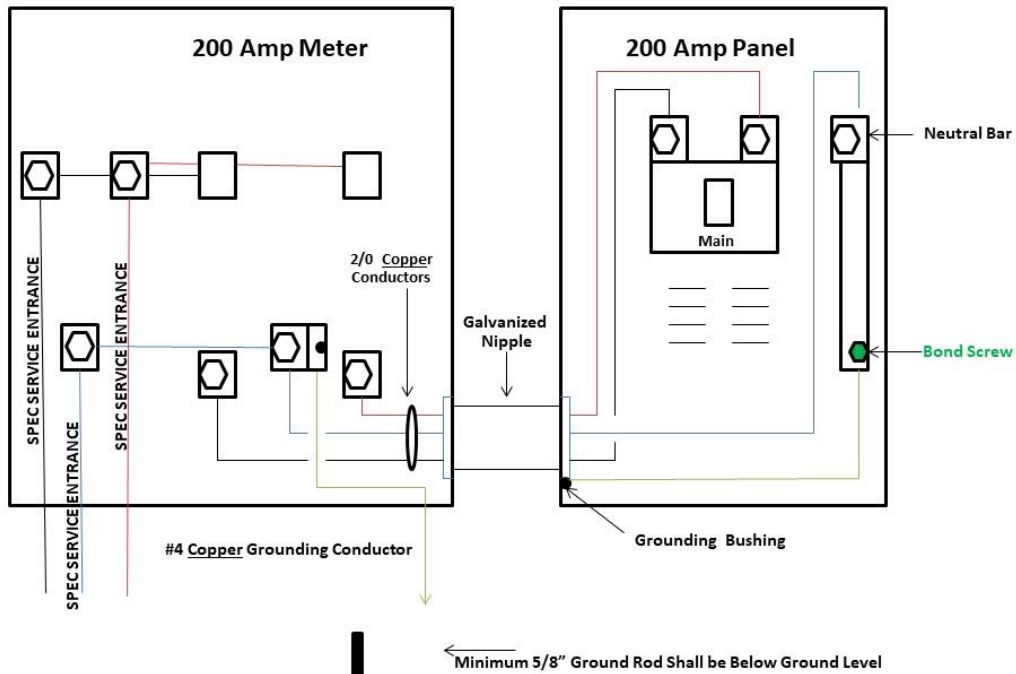

**San Patricio Electric Cooperative - 361-364-2220**  
**Underground Meter Loop – Self Supporting**

1. Ringless Meter Can, underground meter can only. (OH/UG meter are not allowed)
2. Schedule 80 electrical grade PVC (Gray PVC pipe).
3. PVC TA's (Treaded Adapters) with lock rings and plastic bushing from Meter enclosure to panel. If threaded galvanized nipple is used, there must be a bonding bushing installed on the panel side with the ground wire passing through the lug. Chase must be same diameter as riser conduit above meter can. Length must be a minimum of 4" but not more than 6". Lock rings and plastic bushing are required on all nipples and adapters.
4. Breaker panels must have main breaker/fuses. Service disconnects must only add up to 325amps or below. Above 325 amps see Current Transformer (C.T.) meter loop diagram.
5. Minimum #4 ground for 200 amp service. #6 ground for 150 amp service. Ground wire must be in electrical grade PVC.
6. 5/8" x 8' Copper Weld Ground Rod & Clamp shall be fully driven into earth with the top of the rod just below the surface of the ground.
7. Wire and Conduit should be sized according to Service loop. (See chart on back)
  - A. Minimum size #6 copper ground wire up to a 150 amp service and minimum size #4 copper ground wire for a 200 amp service must be installed between the meter can and the breaker box.
  - B. SERVICE CONDUCTOR FEEDERS are connected to the TOPSIDE lugs in the meter can. LOAD SIDE CONDUCTORS to the breaker box are connected to the BOTTOM lugs in the meter can.
  - C. Wire should be sized according to load. See chart on back.
  - D. Conduit should be sized according to wire size. (See chart on back)Note: Cooperative will provide conduit from transformer to bottom of meter can. If you wish to install your own conduit use one 3" Schedule 80 for 200amps and below, and two 3" Schedule 80 for 400amps to 200amps. Above 400amps contact San Patricio Electric Cooperative for sizing.

METER LOOPS MUST BE COMPLETELY ASSEMBLED BY THE MEMBER OR BY AN ELECTRICIAN IN ORDER TO BE CONNECTED. Co-op employees will not help in the assembling of a meter loop on the job site. SPEC has a licensed electrician that builds meter loops and offers other services as well. For a price quote please call the Cooperative at 361-364-2220.

### **CONSTRUCTION of a 3 WIRE METER LOOP**

Meter loop must be assembled and installed by the member or an electrician. The Coop shall determine the acceptability of the meter loop before the connection is made.

Meter Can must be mounted a MINIMUM of 60" from the ground up and a MAXIMUM of 72" from the ground up. This applies to House & Meter Pole installation. Meter Poles must be a minimum of 9' in length and must be set 3' deep in the ground.

Meter and main disconnect must be located on the outside area of any structure and must be accessible to the Cooperative. Disconnect must be located directly beside the meter can. Disconnect must be breakers or fuses. **BLADED DISCONNECT SWITCHES ARE NOT ALLOWED.**

**Mobile Home/Manufactured Home Service Equipment.** The mobile/manufactured home service equipment shall be located adjacent to the mobile/manufactured home and NOT mounted in or on the mobile home. The service equipment shall be located in sight from and not more than 9.0 m (30 ft) from the exterior wall of the home it serves.

Meter loop shall be made of Schedule 80 electrical grade PVC. EMT is not acceptable  
San Patricio Electric Cooperative – Revised October 28, 2024

**San Patricio Electric Cooperative - 361-364-2220**  
**Underground Meter Loop – Self Supporting**

Meter loop must be wired with copper wire from the load side of the meter can to the breaker box.

*Reduced neutral not allowed.*

**San Patricio Electric Cooperative - 361-364-2220**  
**Underground Meter Loop – Self Supporting**

**\*ALLOWABLE AMPERAGE OF AN INSULATED CONDUCTOR**  
**Taken from National Electric Code Manual Table 310-15B**

Copper wire, type THHN maximum temp. 90° centigrade, 600 Volt insulation minimum.

<b><u>Wire Size</u></b>	<b><u>Meter Loop Size</u></b>	<b><u>Conduit Size</u></b>
#2 cu	125 amp Service	1-1/4"
#1/0 cu	150 amp Service	1-1/2"
#2/0 cu	200 amp Service	2"
#3/0 cu	225 amp Service	3"
#350	320 amp Service	4"

**Aluminum Wire Not Allowed**

Consumers may dig their own trench. Charges are still involved. San Patricio Electric Co-op. MUST be contacted BEFORE work is done. Call for information on prices, specifications, contractor insurance requirements, scheduling, etc.

Caution must be taken in selecting the service entrance location to the meter. Cable is buried in conduit. Sharp turns and angles can not be made.

**San Patricio Electric has an electrician that builds meter loops.**  
**For price quotes call the Cooperative at 361-364-2220.**